Installation Manual Octave Ultrasonic Water Meters











1.0 General and Safety

- Do not install, operate or maintain this flow meter without reading, understanding and following the factory-supplied instructions. Otherwise, injury or damage may result.
- Read these instructions carefully before beginning installation and save them for future reference.
- Observe all warnings and instructions marked on the product.
- Consider handling and lifting instructions to avoid damage.
- If the product does not operate normally, refer to the service instructions or to a qualified ARAD service engineer.
- There are no operator-serviceable parts inside this product.

2.0 Product Liability and Warranty

- 3. Arad's standard products (the "Products") are sold to Customer and are purchased by Customer under the terms of warranty set forth herein below:
- 4. Arad warrants that the Products shall, under conditions of normal use and when properly installed, administered, applied and maintained, be free from defects in material and workmanship (the "Warranty"), for a period of 12 months following delivery thereof to Customer (the "Warranty Period").
- 5. Arad's sole obligation and liability under the Warranty shall be limited to the replacement, the repair or the refund of the original purchase price, at Arad's sole discretion, of any defective Products which are proven not to conform to the Products' specification and which are returned to the factory or service center designated by Arad during the Warranty Period by the Customer after completing a failure report. All provided that written notice of such defect is given by the Customer to Arad within 21 days after discovery thereof. Freight cost to such factory or service center will be paid by the Customer and freight cost from such factory or service center to Customer will be paid by Arad.
- 6. Arad will not be responsible for and will have no obligation under the Warranty to any non-conformity of the Products, caused, in whole or in part, as a result of misuse, abuse, tampering with or modification of any of the Products and/or by accidents, fault or negligence, improper administration, application and/or use, installation, service, repair and/or maintenance of the relevant Products, by act of vandalism or by any causes whatsoever (including but not limited to environmental conditions) that are external thereto.
- 7. The foregoing warranty is a limited warranty and is exclusive and in lieu of all other warranties, express or implied, including, but not limited to, the implied warranties of merchantability and fitness for a particular purpose and shall constitute the Customer's sole and exclusive remedy with respect thereto. Replacement or repair in the manner provided above will constitute fulfillment of all of Arad's obligations with respect to the quality and performance of the products. No dealer, distributor, agent or employee of either Arad or customer is authorized to modify these warranties. Such modification shall be null and void and shall not bind Arad for any and all purposes.
- 8. Except and to the extent provided under the warranty, in no event shall Arad be liable, whether in contract, tort or otherwise, for any damages, whether direct or indirect, consequential, incidental, special or punitive, resulting from any defect in the products, including, without limitation, loss of profits, business, income, anticipated savings, goodwill or other commercial loss, even if Arad had been advised of the possibility of such damages, except to the extent that such liability may not lawfully be excluded.

Customer shall be solely responsible for the selection, use, efficiency and suitability of the Products.

3.0 Items Included With Order:

- One OCTAVE ultrasonic flow meter, size as indicated on the packaging box, pieced together into a complete compact system (flow tube plus electronics).
- One OUTPUT module, either digital or analog (based on the customer's order).

4.0 Supplied Documentation:

- · Condensed installation and user manual.
- · Report of factory meter settings.
- · Certificate of calibration data.

5.0 Unpacking and Inspection

- This product has been thoroughly inspected and tested before shipment and is ready for operation.
- After carefully unpacking the meter, inspect for shipping damage before attempting to install. If any indication of mechanical damage is found, immediately contact the responsible transportation service and your local ARAD LTD. representative.



6.0 System Description and Measurement Method

- The OCTAVE's measurement method is based on an ultrasonic, transit-time, dual-beam sensors which determines the length of time it takes an ultrasonic sound wave to travel the distance between the two sensors located on the meter's body. The sensors function as both the sender and the receiver, each one alternating these functions so that the ultrasonic wave travels both with and against the direction of the flow. Since the ultrasonic wave travels slower against the flow than with the flow, the time difference of two waves traveling with and against the flow leads to determining the velocity of the water.
- The OCTAVE ultrasonic flow meter is a battery-powered precision flow meter designed for linear, bidirectional flow measurement of water.
- Flow measurement values can be transferred through the standard comminucation digital or analog output.
- The OCTAVE can be set up for a wide range of applications.

7.0 Notes

- For proper flow measurements, the OCTAVE's measuring tube should be completely full at all times. Non-wetted sensors show loss of signal. Though this will not cause damage to the meter, it will, however, not measure flow and display zero.
- Flow direction: The OCTAVE is a bidirectional flow meter. Note the indicating arrow on the OCTAVE's display for forward and backward flows.
- In case of direct sunlight exposure, it is recommended to keep the lid closed, though no direct damage will occur with the lid open.
- Do not expose the OCTAVE to excessive vibration. To avoid vibration, support the pipeline on both side of the meter
- Ambient working temperature: -25 to +55°C.
- Water working temperature: 0.1 to +50°C.
- To avoid measuring errors due to air in the flow tube, observe the following precautions:
- Since air collects at the highest point of the system, installation of the flowmeter should be at the lowest point.
 - Always install control valves downstream of the meter in order to avoid cavitation.
 - Never install the meter on a pump suction side in order to avoid cavitation.


8.0 Counter Flanges

- Refer to the standard dimensional drawings for flange spacing, accommodating for the thickness of gaskets.
- Install meter in line with the pipe axis. The flange faces must be parallel to each other.
- Permissible length deviation: Lmax Lmin 0.5mm (0.02").

9.0 Start-up

- Check that the meter has been installed correctly (Please refer to mechanical installation guide Page 5).
- · Check that the flow rate and volume units are correctly preprogrammed on the display.
- · Check that the output module is correctly attached.

10.0 Digital Display Mechanical Data

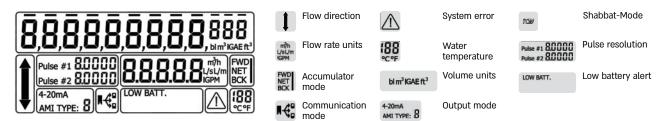



Sleep Mode - After 24h (or according to any default choosen) of empty pipe line/ pipe without water the meter will switch to sleep mode.



11.0 Mechanical Data

| Maximum Working Pressure | 16 bar |
|--------------------------|---|
| Liquid Temperature | 0.1 up to 50 ° C |
| Precision Class | ISO 4064 rev.2014, Accuracy class 2 |
| Configuration | Compact - The display is built in to the unit |
| Power Source | 2 D size Li-battery: up to 15 years life time |
| Environmental Protection | IP 68, Ambient operation temp25°C up to +55°C |
| Volume Display Options | Net (Forward less reverse) Forward only Reverse only Forward & reverse alternating |
| Data Logger | Volumes and alarms data (48KB, 4130 data points) |
| Connections | 1½-2" threaded: with couplings to NPT/ BSP 2"-12" flanged: flanges according to ISO, BS 10 and ANSI 150 |
| Severity levels | Mechanical class M1 Electromagnetic environment class E1 |
| Pressure Loss | ΔP 0.16 bar |
| | |

Outputs

| outputo | | | | | |
|-------------------------|---|---|--|--|--|
| Analog Output | The Analog Output shows the currently me | | | | |
| | This output is a 4 - 20 mA current loop (the | | | | |
| | The Analog Output is programmable for forward and reverse flow (see Operation Manual for more details). | | | | |
| | | omer request (To any flow lower than the max flow of the meter). | | | |
| Digital (pulse) Output | | transistor output that provides pulse per quantity with these options | | | |
| . , , . | 1. Two scaled forward and/or reverse mode pulses | | | | |
| | 2. One scaled forward pulse and one ala | | | | |
| | , | programmed different than displayed units | | | |
| | Pulse resolution will be shown on the displ | lay for each pulse separately. | | | |
| Dry Contact Output | The Dry Contact Output is a dual mechanical relay output that provides pulse per quantity with these options: | | | | |
| · | 1. Two scaled forward and/or reverse mode pulses | | | | |
| | 2. One scaled forward pulse and one ala | rm frequency output | | | |
| | 3. Measuring units of the output can be programmed different than displayed units | | | | |
| | Pulse resolution will be shown on the display for each pulse separately. | | | | |
| | Onsite power supply of 5-35 VDC is needed. | | | | |
| SSR (Solid State Relay) | The SSR is a dual electronic relay output that provides pulse per | | | | |
| ` '' | quantity with these options: | | | | |
| | Two scaled forward and/ or reverse pulses | | | | |
| | 2. One scaled forward and one alarm frequency output | | | | |
| | 3. Measuring units of the output can be programmed different than displayed units | | | | |
| | Pulse resolution will be shown on the display for each pulse separately. | | | | |
| | Onsite power supply of 5-35 VDC is needed | d. | | | |
| Encoder Output | The Encoder Output is a serial communicat | tion protocol utilizing UI1203 or UI1204 (Sensus protocol). | | | |
| | Additional pulse output is available as an option. | | | | |
| Modbus Protocol Output | The Modbus Protocol Output has the follow | ving available functions: | | | |
| / M-Bus | 1. Alarms (battery, empty pipe) | 6. Current flow | | | |
| | 2. AMR serial number | 7. Flow direction | | | |
| | 3. Real Time Clock (RTC) | 8. Forward and reverse volumes | | | |
| | 4. Volume units | 9. Flow and volume resolution | | | |
| | 5. Flow rate units | | | | |
| Output Extension Cable | 5m extension cable for installation in pits a | nd vaults | | | |
| | <u> </u> | | | | |





Dimensions

| Model | | Octave | | | | | | | | | |
|-----------------------------------|---------|----------------|----------------|-----|------|-----|-----|-----|-----|-----|-----|
| Nominal size | (mm) | 40 Threaded | 50 Threaded | 50 | 65 | 80 | 100 | 150 | 200 | 250 | 300 |
| | (inch) | 1½ Threaded | 2 Threaded | 2 | 2.5 | 3 | 4 | 6 | 8 | 10 | 12 |
| L - Length without couplings (mm) | | 300 | 300 | 200 | 200 | 225 | 250 | 300 | 350 | 449 | 499 |
| W - Width (mm) | | 113 | 113 | 165 | 185 | 200 | 220 | 285 | 340 | 406 | 489 |
| H - Height (mm) | | 155 | 155 | 194 | 210 | 210 | 223 | 282 | 332 | 383 | 456 |
| h - Height (mm) | | 35 | 35 | 40 | 90 | 90 | 103 | 140 | 165 | 203 | 245 |
| Weight (kg) - cast iron body | | | 8 | 9 | 11.5 | 13 | 15 | 32 | 45 | 68 | 96 |
| Weight (kg) - body | polymer | 1.4 | 1.45 | | | | | | | | |

Dimensions Stainless Steel Meters (AWWA flanges only)

| Mode | Octave Stainless Steel | | | | | |
|--------------------------------------|------------------------|-----|------|-----|-----|-----|
| Nominal size | (mm) | 50 | 80 | 100 | 150 | 200 |
| Nominal Size | (inch) | 2 | 3 | 4 | 6 | 8 |
| L - Length without couplings (mm) | | 254 | 305 | 356 | 457 | 508 |
| W - Width (mm) | | 147 | 190 | 229 | 280 | 343 |
| H - Height (mm) | | 165 | 216 | 250 | 276 | 327 |
| h - Height (mm) | | 53 | 90 | 115 | 130 | 162 |
| Weight (kg)- stainless steel body | | 5.5 | 11.5 | 17 | 27 | 51 |

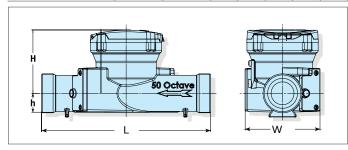

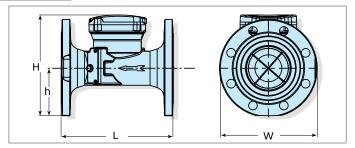

1.0 12.0 **Mechanical Data**

Note:


12.1 Handling the Flow Meter

Important handling information:


- Do not lift the Octave by the electronic housing.
- Do not carry the Octave by its lid.
- Do not place the Octave on the electronic housing.
- · When handling the Octave, avoid hard blows, jolts or impacts.

Installation: Location and Position 12.2


The Octave needs to operate with downstream back pressure of minimum 0.5-0.7 Bar. Do not install the meter with a fully open downstream pipe (with no back pressure).



Conditional installation



Wrong installation







The Following Examples are Arad's Recommendations For Achieving Top Performance

- When installing the Octave downstream of any hydraulic component (valve, pump) the recommended installation requirements are no less than the drawings recommendations.


 For upstream & downstream straight pipes please use as much as installation site will allow (the longer the better)
- When installing Pressure Breaker after the meter the pipe length should be at least 2 pipe diameter (the longer the better).




2 pipe diameters before and after elbows (90°)




Minimum of two (2) pipe diameters before and after




Minimum of ten (10) pipe diameters after pumps



Minimum of two (2) pipe diameters before T connections



Minimum of two (2) pipe diameters after strainers



2 pipe diameters before and after elbows (90°) in vertical installations



13.0 Polymeric Octave Installation - General Instructions

Please follow the general instructions for water meters (Check Valve, upstream & down stream and system flushing on new installations).

Existing and new installations:

1. It is recommended that the meter will NOT be installed in the middle of the system, so the meter will not suffer from the load of all the installed fixtures.




2. It is recommended that at least one side of meter will be connected to a PVC (or plastic) pipe.



3. Please make sure that the end connections are parallel and inline to each other.




- 4. When using standard tail piece, please use rubber gaskets only (not fiberglass)! After adding the gaskets the gap between the end connection and the meter should not exceed 1mm. Please unscrew the end connection in order to keep the recommended distance.
- Please do not use force in order to close the gap.
- Please don't do any welding while the meter is connected to the pipe.





5. If it is not possible to use plastic connections on one side of the meter, please consider the use of our flexible couplings. These couplings were especially developed for the polymeric Octave meters.

You will need to use this coupling only on one side of the meter - please install the coupling on the outlet, if possible - as described in the below pictures.

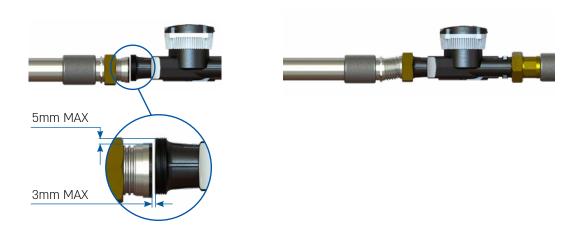


6. Please start to tighten the end connections by hand. Final tightening will be with no more than 100Nm torque.



7. Please don't do any welding while the meter is connected to the pipe.



8. In case it is not possible to use plastic end connections (at least on one side), please support the meter as shown in the drawing below.

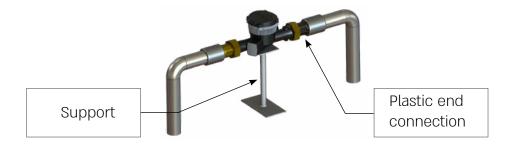




14.0 Electrical Outputs

- 1. Open Drain dual output
- 2. Dry Contact dual output
- 3. SSR dual output
- 4. Analog output (4-20mA)
- 5. MODBUS output
- 6. M bus output

14.1. Open Drain dual output

Connections Diagram

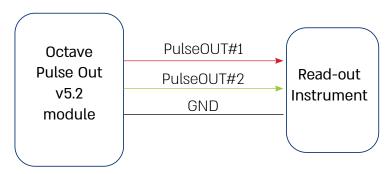

Cables

| | Wire | Function |
|------------|-------|-------------|
| Long cable | Red | Pulse Out#1 |
| Long odbio | Green | Pulse Out#2 |
| | Black | GND ND |


| Outputs Type | Open Drain |
|-------------------------|---------------|
| Cable Length - supplied | 1.5/5 [meter] |
| Maximum Cable Length* | 500 [meter] |
| Maximum Applied Voltage | 35 [Vdc] |
| Maximum load | 200 [mA] |

^{*} Cable Teldor PN 8005003101 or similar



14.2. Dry Contact dual output

Connections Diagram

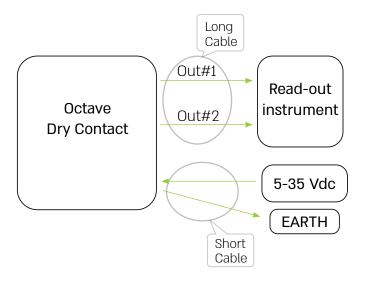

Cables

| | Wire | Function |
|---------------|---------------|----------|
| Long cable | Red + Orange | Out#1 |
| | Black + Brown | Out#2 |
| Short cable * | Red | 5-35V+ |
| | Black | 5-35V- |
| | Yellow | Earth |

^{*} Signal connection polarity is mandatory!


| Outputs Type | Dry Contact |
|-------------------------|---------------|
| Cable Length - supplied | 1.5/5 [meter] |
| Maximum Cable Length* | 500 [meter] |
| Supply Voltage | 5-35 [Vdc] |
| Switching Power max. | 15 [Watt] |
| Life Expectancy | 10° [Cycles] |

^{*} Cable Teldor PN 8005003101 or similar



14.3. SSR dual output

Connections Diagram

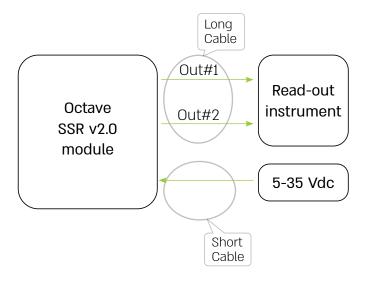

Cables

| Long cable | Wire | Function | |
|---------------|---------------|----------|--|
| | Red + Orange | Out#1 | |
| | Black + Brown | Out#2 | |
| | | | |
| Short cable * | Red | 5-35V + | |
| | Black | 5-35V - | |

^{*} Optional

Signal connection polarity is mandatory!

| Outputs Type | Bi-directional Solid State Relay | | | | |
|------------------------------|----------------------------------|--|--|--|--|
| On-Resistance max. | 25 [Ω] | | | | |
| Minimum Pulse Width | 10 [msec] | | | | |
| Output current max. | 120 [mA] | | | | |
| Total Power Dissipation max. | 800 [mW] | | | | |
| Supply Voltage | 5-35 [Vdc] | | | | |
| Cable Length - supplied | 1.5 [meter] | | | | |
| Maximum Cable Length* | 500 [meter] | | | | |
| | | | | | |

^{*} Cable Teldor PN 8005003101 or similar



The SSR module is powered by internal battery.

External power supply in a range of 5-35Vdc could be used for certain Pulse parameters and Flow Rate combination.

Pulse resolution or Pulse width are directly affect the internal battery lifetime.

The following setup examples showing the calculated internal battery lifetime for 10 and 5 years:

| 10 years | No. of Outputs | Q4 [m3/h] | Pulse Resolution [m3/pulse] | Pulse Width [msec] | Calculated battery lifetime [years] |
|----------|-------------------|--------------|-----------------------------------|-----------------------|---|
| DN-50 | 2 | 50 | 0.01 | 30 | 11.4 |
| טוע-30 | 2 | 50 | 0.01 | 30 | 11.4 |
| DN-80 | 2 | 80 | 0.01 | 20 | 10.7 |
| DN-100 | 2 | 125 | 0.01 | 12 | 11.4 |

| 5 years | No. of Outputs | Q4 [m3/h] | Pulse Resolution [m3/pulse] | Pulse Width [msec] | Calculated battery lifetime [years] |
|---------|-------------------|--------------|-----------------------------------|-----------------------|---|
| DN-50 | 2 | 50 | 0.001 | 7 | 5.1 |
| טט-אום | 2 | 50 | 0.01 | 70 | 5.1 |
| DN-80 | 2 | 80 | 0.01 | 45 | 5.0 |
| DN-100 | 2 | 125 | 0.01 | 30 | 4.8 |




14.4. Analog output 4-20mA

- The current output is a passive 4-20mA. Power needs to be supplied by the customer.
- 4mA is always "0" (zero) flow and the 20mA is programmable according to the customer requirements. (If the customer did not specify, the 20mA will be the maximum flow rate).

14.4.1. Indor installation

Connections Diagram

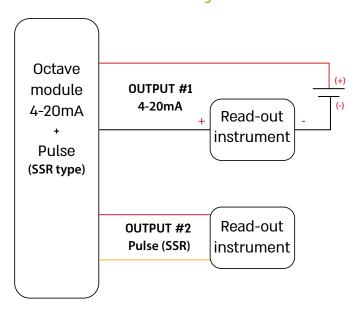

OUTPUT #1 4-20mA

Cables

| Wire | Function |
|-------|----------------|
| Red | current loop + |
| Black | current loop - |

Output Characteristics

| Outputs Type | 4-20mA current output |
|-----------------------|--------------------------|
| Supplied Cable Length | 1.5 [meter] |
| Maximum Cable Length* | 500 [meter] |
| Loop supply voltage | 12 - 24 [Vdc] |
| Output Impedance | 25 [MΩ] typ |

^{*} Cable Teldor PN 8005003101 or similar

OUTPUT #2 Pulse (SSR)

Cables

| | Wire | Function |
|------------|--------|----------|
| Long cable | Red | Out#2 |
| | Orange | Out#2 |


| output onuractoristics | | |
|------------------------------|-------------------------------------|--|
| Outputs Type | Bi-directional Solid State Relay | |
| On-Resistance max. | 25 [Ω] | |
| Minimum Pulse Width | 10 [msec] | |
| Output current max. | 120 [mA] | |
| Total Power Dissipation max. | 800 [mW] | |
| Supply Voltage | 5-35 [Vdc] | |
| Cable Length - supplied | 1.5 [meter] | |
| Maximum Cable Length* | 500 [meter] | |
| | | |

^{*} Cable Teldor PN 8005003101 or similar



14.4.2. Outdor installation

Connections Diagram

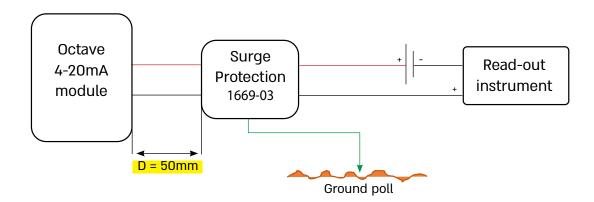

Cables

| Wire | Function |
|-------|----------------|
| Red | current loop + |
| Black | current loop - |

Surge Protector

In regions with potential surge and lightnings it is suggested to add Surge Protector of type - Bourns 1669-03.

Important: Assembly distance from the Octave 20-4mA module - no more than 100mm!

The protector wiring is AWG #20 (0.5 mm2).

The solid colored red and black wires are to be connected to the 4-20mA modfule output, while the striped red/white and black/white wires (the 'protected' output) connect to the terminals of the field device.

Minimize looping of the solid colored input and ground conductors to reduce field coupling of surges into the protected output.


Grounding

The protector body (stainless steel nipple) and green wire are electrically common. The green wire should connect to a grounding pole verifed by the elctricity local company . The green ground wire shuld be a 2.5 mm diameter at least



14.5. Modbus output

Connections Diagram

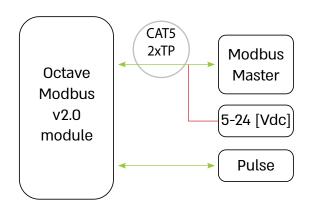

Cables

| ModBus | Wire | Function |
|--------|--------------|-----------|
| | Blue | D0/A/Tx+ |
| | White/Blue | D1/B/Tx- |
| | Orange | 5-24Vdc |
| | White/Orange | Ground |
| | | |
| Pulse* | Red | Pulse Out |
| | Black | Ground |

^{*} Optional


| Outputs Type | RS485 |
|-----------------------|--------------|
| Max Baud Rate | 9600 [BPS] |
| Max Power Consumption | 80 [mW] |
| Supply Voltage Range | 5 - 24 [Vdc] |
| Max Cable Length | 1000 [Meter] |

^{*} Cable Teldor PN 8005003101 or similar



14.6. M-Bus output

Connections Diagram

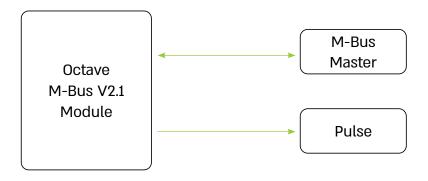

Cables

| M-Bus | Wire | Function |
|--------|-------|-----------|
| | Red | BUSL1 |
| | Black | BUSL2 |
| | | |
| Pulse* | Red | Pulse Out |
| | Black | Ground |

^{*} Optional

| Outputs Type | M-Bus |
|-----------------------|---------------|
| Max Baud Rate | 9600 [BPS] |
| Max Power Consumption | 80 [mW] |
| M-Bus Voltage | 24 - 36 [Vdc] |
| Max Cable Length* | 3 [Meter] |

^{*} Cable Teldor PN 8005003101 or similar



15.0 Module Replacement / Mounting Manual

1. Properly dry the area of the connector.





- 2. Remove seal cover from the screw using tool with sharp edge.
- 3. Remove the screws using Allen key 3mm.
- 4. Remove the module/cover.
- 5. Properly dry again the area of the connector.
- 6. Make sure the module o-ring is in position.

 If not, Insert new o-ring into the module. The o-ring must be lubricated (silicone grease)



7. Attach module to the connector.





8. Tight both screws by hand only, using Allen key 3 mm to achieve symmetric o-ring pressure, then apply the torque 2 N*m with torque wrench.





9. Insert seal cover onto the screw.











EU Declaration of Conformity

Product line: Octave Ultrasonic Water meters

Sized 40 up to 300 mm



We Arad ltd.

Declare under our sole responsibility, that the above mentioned product line is consistent with the type described in the certificate SK 20-MI001-SMU062 revision 3 (issued 09 January 2023 valid until 14 August 2030) approved by the Notified Body 1781 Slovak Institute of Metrology in accordance with Directives 2014/32/EU Annex II ,Module B.

The quality system for production, final product inspection and testing of the water meters (MI-001) was approved by the Notified Body 1781 Slovak Institute of Metrology in accordance with Directive 2014/32/EU Annex II Module D (Certificate No. SK 23-QD-SMU013 rev.1, issued April 12 2023 and valid until 3 January 2026.

The object of the declaration described above is in conformity with the requirements of the following directive/s:

Directive 2014/32/EU of the European parliament and of the council of 26 February 2014 on the harmonisation of the laws of the Member States relating to the making available on the market of measuring instruments.

Directive 2014/30/EU of the European parliament and of the council of 26 February 2014 on the harmonisation of the laws of the Member States relating to electromagnetic compatibility.

Harmonized standards and normative documents used:

OIML R 49-1:2006. -Water meters intended for the metering of cold potable water and hot water.

Part 1: Metrological and technical requirements

OIML R 49-2:2004 -Water meters intended for the metering of cold potable water and hot water.

Part 2: Test methods

EN 14154-1:2005+A2:2011 Water meters - Part 1: General requirements

EN 14154-2:2005+A2:2011 Water meters - Part 2: Installation and conditions of use

EN 14154-3:2005+A2:2011 Water meters - Part 3: Test methods and equipment

Other instructions used:

OIML R 49-1:2013 -Water meters intended for the metering of cold potable water and hot water.

Part 1: Metrological and technical requirements.

OIML R 49-2:2013 -Water meters intended for the metering of cold potable water and hot water.

Part 2: Test methods.

OIML R 49-3:2013 -Water meters intended for the metering of cold potable water and hot water.

Part 3: Test report format.

EN ISO 4064-1: 2017 -Water meters for cold potable water and hot water.

Part 1: Metrological and technical requirements

EN ISO 4064-2: 2017 -Water meters for cold potable water and hot water. Part 2: Test methods.

EN ISO 4064-5: 2017 -Water meters for cold potable water and hot water. Part 5: Installation requirements.

Signed for and on behalf of: Arad ltd, Dalia 1923900, Israel

Date: 17/04/2023

Signed by : Nastiya Rubin, Product Certification Manager

Nastiya Rubin Arad Ltd.

Arad Ltd. | Dalia 1923900, Israel | Tel: 972-4-9897911, Fax: 972-4-9897960 | www.arad.co.il





Specifications are subject to change without notice.

For the most updated version, please check our website: www.arad.co.il





